



Listing and Technical Evaluation Report™

Report No: 1811-03



Issue Date: June 14, 2019

Revision Date: April 9, 2024

Subject to Renewal: July 1, 2025

QuickTie™ U-Hanger Series Face Mount Joist Hangers

Trade Secret Report Holder:

QuickTie™ Products, Inc.

Phone: 904-281-0525

Fax: 904-281-0526

Website: www.quicktieproducts.com

CSI Designations:

DIVISION: 06 00 00 - WOOD, PLASTICS AND COMPOSITES

Section: 06 05 23 - Wood, Plastic, and Composite Fastenings

1 Innovative Products Evaluatedⁱ

1.1 QuickTie U-Hanger Series:

- 1.1.1 UL Series – 20-gauge
- 1.1.2 ULP & ULP-IF (Inverted Flange) Series – 18-gauge
- 1.1.3 UM Series – 16-gauge
- 1.1.4 UH & UH-IF (Inverted Flange) Series – 14-gauge
- 1.1.5 TSH Series - 14-gauge, 16-gauge and 18-gauge
- 1.1.6 TFLP (Top Flange) Series – 18-gauge
- 1.1.7 TFH (Top Flange) Series – 14-gauge

2 Product Description and Materials

2.1 The innovative products evaluated in this report are shown in **Figure 1**, **Figure 2**, **Figure 3** and **Figure 4**.

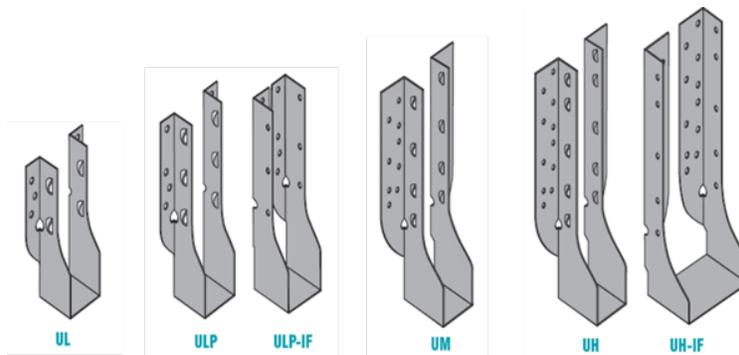


Figure 1. UL, ULP, ULP-IF, UM, UH and UH-IF Hangers

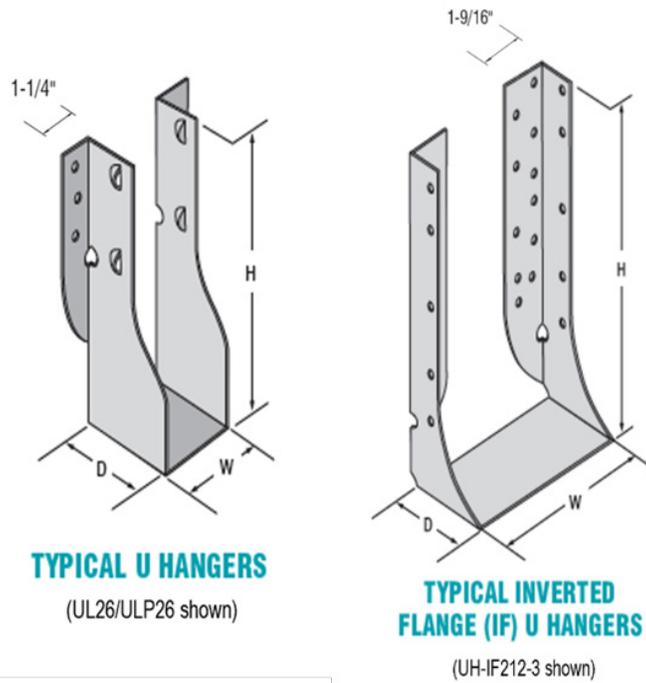


Figure 2. Typical Hanger Configuration

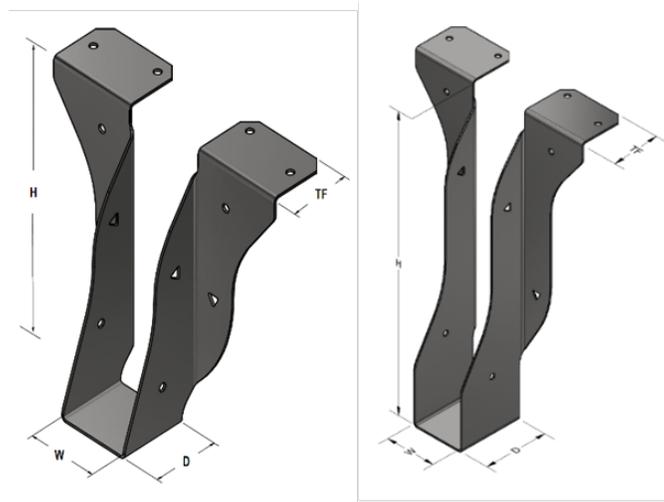


Figure 3. Top Flange TFLP and TFH Hangers

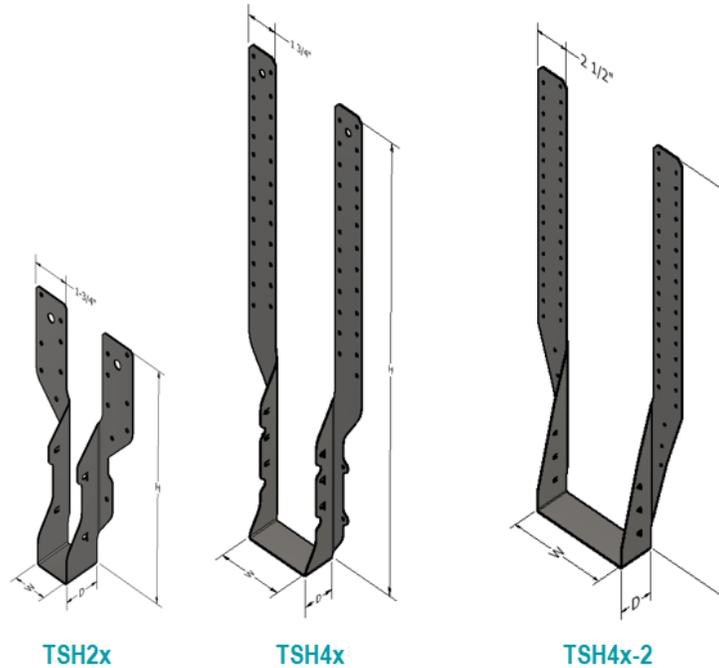


Figure 4. TSH Hangers

- 2.1.1 QuickTie U-Hanger Series Face Mount and Top Flange Mount Joist Hangers are manufactured from minimum ASTM A653, Structural Steel, Grade 40 ($F_u = 55$ ksi, $F_y = 40$ ksi) steel galvanized with a G90 or better zinc coating, with the exception of the ULP24, ULP24-2, TSH Series and TFH Series hangers which are Grade 50 ($F_u = 70$ ksi, $F_y = 50$ ksi).
- 2.1.2 The U-Hanger series are designated as follows:
- 2.1.2.1 UL Series – 20-gauge (minimum coated thickness = 0.0356")
 - 2.1.2.2 ULP & ULP-IF Series – 18-gauge (minimum coated thickness = 0.0466")
 - 2.1.2.3 UM Series – 16-gauge (minimum coated thickness = 0.0575")
 - 2.1.2.4 UH & UH-IF Series – 14-gauge (minimum coated thickness = 0.0705")
 - 2.1.2.5 TFLP26 and TFLP28 – 18-gauge (minimum coated thickness = 0.0466")
 - 2.1.2.6 TFH210, and TFH214 – 14-gauge (minimum coated thickness = 0.0705")
 - 2.1.2.7 TSH29, TSH213, TSH218 and TSH418 – 18-gauge (minimum coated thickness = 0.0466")
 - 2.1.2.8 TSH218-2, TSH222-2, TSH413, TSH422 and TSH422-2 – 16-gauge (minimum coated thickness = 0.0575")
 - 2.1.2.9 TSH426 and TSH426-2 – 14-gauge (minimum coated thickness = 0.0705")
- 2.2 As needed, review material properties for design in **Section 6** and to regulatory evaluation in **Section 8**.



3 Definitions

- 3.1 New Materialsⁱⁱ are defined as building materials, equipment, appliances, systems, or methods of construction not provided for by prescriptive and/or legislatively adopted regulations, known as alternative materials.ⁱⁱⁱ The design strengths and permissible stresses shall be established by tests^{iv} and/or engineering analysis.^v
- 3.2 Duly Authenticated Reports^{vi} and Research Reports^{vii} are test reports and related engineering evaluations, which are written by an approved agency^{viii} and/or an approved source.^{ix}
- 3.2.1 These reports contain intellectual property and/or trade secrets, which are protected by the Defend Trade Secrets Act (DTSA).^x
- 3.3 An approved agency is “approved” when it is ANAB ISO/IEC 17065 accredited. DrJ Engineering, LLC (DrJ) is listed in the ANAB directory.
- 3.4 An approved source is “approved” when a professional engineer (i.e., Registered Design Professional) is properly licensed to transact engineering commerce. The regulatory authority governing approved sources is the state legislature via its professional engineering regulations.^{xi}
- 3.5 Testing and/or inspections conducted for this Duly Authenticated Report were performed by an ISO/IEC 17025 accredited testing laboratory, an ISO/IEC 17020 accredited inspection body, and/or a licensed Registered Design Professional (RDP).
- 3.5.1 The Center for Building Innovation (CBI) is ANAB^{xii} ISO/IEC 17025 and ISO/IEC 17020 accredited.
- 3.6 The regulatory authority shall enforce^{xiii} the specific provisions of each legislatively adopted regulation. If there is a non-conformance, the specific regulatory section and language of the non-conformance shall be provided in writing^{xiv} stating the nonconformance and the path to its cure.
- 3.7 The regulatory authority shall accept Duly Authenticated Reports from an approved agency and/or an approved source with respect to the quality and manner of use of new materials or assemblies as provided for in regulations regarding the use of alternative materials, designs, or methods of construction.^{xv}
- 3.8 ANAB is an International Accreditation Forum (IAF) Multilateral Recognition Arrangement (MLA) signatory where recognition of certificates, validation, and verification statements issued by conformity assessment bodies accredited by all other signatories of the IAF MLA with the appropriate scope, shall be approved.^{xvi} Therefore, all ANAB ISO/IEC 17065 Duly Authenticated Reports are approval equivalent.^{xvii}
- 3.9 Approval equity is a fundamental commercial and legal principle.^{xviii}

4 Applicable Standards for the Listing; Regulations for the Regulatory Evaluation^{xix}

4.1 Standards

- 4.1.1 *ANSI S100: North American Specification for the Design of Cold-formed Steel Structural Members*
- 4.1.2 *ANSI/AISC 360: Specification for Structural Steel Buildings*
- 4.1.3 *ANSI/AWC NDS: National Design Specification (NDS) for Wood Construction*
- 4.1.4 *ASTM A370: Standard Test Methods and Definitions for Mechanical Testing of Steel Products*
- 4.1.5 *ASTM A653: Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process*
- 4.1.6 *ASTM D7147: Standard Specification for Testing and Establishing Allowable Loads of Joist Hangers*
- 4.1.7 *ASTM F1575: Standard Test Method for Determining Bending Yield Moment of Nails*



4.2 Regulations

- 4.2.1 IBC – 15, 18, 21: International Building Code®
- 4.2.2 IRC – 15, 18, 21: International Residential Code®
- 4.2.3 FBC-B—20, 23: Florida Building Code – Building^{xx} (FL 3557)
- 4.2.4 FBC-R—20, 23: Florida Building Code – Residential^{xx} (FL 3557)
- 4.2.5 NCBC—12, 18: North Carolina Building Code

5 Listed^{xxi}

- 5.1 A nationally recognized testing laboratory such as CBI, states that the materials, designs, methods of construction, and/or equipment have met nationally recognized standards and/or have been tested and found suitable for use in a specified manner.

6 Tabulated Properties Generated from Nationally Recognized Standards

6.1 General

- 6.1.1 QuickTie U-Hanger Series Face Mount and Top Flange Mount Joist Hangers are used to resist gravity loads and uplift loads due to wind in one-ply, two-ply and three-ply joist assemblies in light-frame wood construction.
- 6.1.2 QuickTie U-Hanger Series Face Mount and Top Flange Mount Joist Hangers are used as wood framing connectors in accordance with IBC Section 2304.10.4^{xxii} and IRC Section R301.1.3.

6.2 Hanger Design Values

- 6.2.1 **Table 1** through **Table 6** give the allowable gravity and uplift loads for U-Hanger connectors with single-ply and multi-ply nominal lumber joists.
- 6.2.2 **Table 7** through **Table 9** give the allowable gravity and uplift loads for top and face mounted joist hangers with single-ply and multi-ply lumber trusses/rafters/joists.
- 6.2.3 The design values in **Table 1** through **Table 9** were derived using the applicable adjustment factors in ASTM D7147 per IBC Section 2303.5.
- 6.2.4 The responsible design professional for the project shall determine which type of U-Hanger is appropriate using **Table 1** through **Table 9**.

6.3 Table Notes

- 6.3.1 The following notes apply to **Table 1** through **Table 9**:
 - 6.3.1.1 Nails designated as 16d shall be 16d common nails (0.162" x 3.5", $F_{yb} = 90,000$ psi) and 10d shall be 10d common nails (0.148" x 3", $F_{yb} = 90,000$ psi), unless otherwise noted in the tables.
 - 6.3.1.2 Allowable loads are provided for load duration factors (C_D) of 1.0, 1.15, 1.25 and 1.6.
 - 6.3.1.3 Allowable loads labeled "Floor" and "Roof" represent gravity loads.
 - 6.3.1.4 **Figure 5** and **Figure 6** in show the example of installation of typical U Hangers and Inverted Flange (IF) U Hangers.
 - 6.3.1.5 **Figure 7** in shows the example of installation of Top Flange Hangers.
 - 6.3.1.6 **Figure 8** in shows the examples of installation of TSH Hangers.



Table 1. UL Series Hangers – Allowable Gravity and Uplift Loads (Ibf)¹

Part No. UL Series (1, 2 and 3-ply joists)	Joist Size (in)	Hanger Dimensions (in)			Steel Thick.	Fasteners				SP/DF-L (G=0.50)				HF/SPF (G=0.42)			
		Width, W	Height, H	Depth, W		Header		Joist		Floor	Roof	Roof	Uplift	Floor	Roof	Roof	Uplift
						Qty	Size	Qty	Size	1.0	1.15	1.25	1.6	1.0	1.15	1.25	1.6
UL26	2x6	1 ⁵ / ₈	5 ³ / ₈	1 ³ / ₄	20- gauge	6	16d	4	16d	1,215	1,215	1,215	510	965	965	965	440
UL26-2		3 ¹ / ₈	4 ⁵ / ₈														
UL26-3		4 ⁵ / ₈	3 ⁷ / ₈														
UL28	2x8	1 ⁵ / ₈	7 ¹ / ₈	1 ³ / ₄	20- gauge	8	16d	6	16d	1,695	1,855	1,895	910	1,400	1,455	1,490	785
UL28-2		3 ¹ / ₈	6 ³ / ₈														
UL28-3		4 ⁵ / ₈	5 ⁵ / ₈														
UL210	2x10	1 ⁵ / ₈	9 ¹ / ₈	1 ³ / ₄	20- gauge	10	16d	8	16d	2,175	2,495	2,575	1,315	1,835	1,940	2,010	1,130
UL210-2		3 ¹ / ₈	8 ³ / ₈														
UL210-3		4 ⁵ / ₈	7 ⁵ / ₈														
UL212	2x12	1 ⁵ / ₈	10 ³ / ₁₆	1 ³ / ₄	20- gauge	10	16d	10	16d	1,570	1,570	1,570	1,715	1,265	1,265	1,265	1,475
UL212-2		3 ¹ / ₈	9 ⁷ / ₁₆														
UL212-3		4 ⁵ / ₈	8 ¹¹ / ₁₆														

SI: 1 in. = 25.4 mm
1. See notes in Section 6.3.1.

Table 2. ULP Series Hangers – Allowable Gravity and Uplift Loads (Ibf)¹

Part No. ULP (1, 2 and 3-ply Joists)	Joist Size (in)	Hanger Dimensions (in)			Steel Thick.	Fasteners				SP/DF-L (G=0.50)				HF/SPF (G=0.42)			
		Width, W	Height, H	Depth		Header		Joist		Floor	Roof	Roof	Uplift	Floor	Roof	Roof	Uplift
						Qty	Size	Qty	Size	1.0	1.15	1.25	1.6	1.0	1.15	1.25	1.6
ULP24	2x4	1 ⁵ / ₈	3 ¹ / ₈	1 ³ / ₄	18- gauge	6	10d	2	10d or 10d x 1 ¹ / ₂	500	500	500	380	430	430	430	325
ULP24-2		3 ¹ / ₈															
ULP24		1 ⁵ / ₈															
ULP24-2		3 ¹ / ₈															
ULP26	2x6	1 ⁵ / ₈	5 ³ / ₈	1 ³ / ₄	18- gauge	6	16d	4	16d	1,230	1,415	1,435	670	1,065	1,110	1,110	580
ULP26R		2	5 ¹ / ₈														
ULP26-2		3 ¹ / ₈	4 ⁵ / ₈														
ULP26-3		4 ⁵ / ₈	3 ⁷ / ₈														



Table 2. ULP Series Hangers – Allowable Gravity and Uplift Loads (lbf)¹

Part No. ULP (1, 2 and 3-ply Joists)	Joist Size (in)	Hanger Dimensions (in)			Steel Thick.	Fasteners				SP/DF-L (G=0.50)				HF/SPF (G=0.42)			
		Width, W	Height, H	Depth		Header		Joist		Floor	Roof	Roof	Uplift	Floor	Roof	Roof	Uplift
						Qty	Size	Qty	Size	1.0	1.15	1.25	1.6	1.0	1.15	1.25	1.6
ULP36	3x6	2 ⁹ / ₁₆	4 ⁷ / ₈														
ULP46	4x6	3 ⁹ / ₁₆	4 ³ / ₈														
ULP28	2x8	1 ⁵ / ₈	7 ¹ / ₈	1 ³ / ₄	18- gauge	8	16d	6	16d	1,710	1,955	2,005	1,025	1,450	1,525	1,560	890
ULP28R		2	6 ⁷ / ₈														
ULP28-2		3 ¹ / ₈	6 ³ / ₈														
ULP28-3		4 ⁵ / ₈	5 ⁵ / ₈														
ULP38	3x8	2 ⁹ / ₁₆	6 ⁵ / ₈														
ULP48	4x8	3 ⁹ / ₁₆	6 ¹ / ₈														
ULP210	2x10	1 ⁵ / ₈	9 ¹ / ₈	1 ³ / ₄	18- gauge	10	16d	8	16d	2,190	2,495	2,575	1,375	1,835	1,940	2,010	1,200
ULP210R		2	8 ⁷ / ₈														
ULP210-2		3 ¹ / ₈	8 ³ / ₈														
ULP210-3		4 ⁵ / ₈	7 ⁵ / ₈														
ULP310	3x10	2 ⁹ / ₁₆	8 ⁵ / ₈	1 ³ / ₄	18- gauge	10	16d	8	16d	2,190	2,495	2,575	1,375	1,835	1,940	2,010	1,200
ULP410	4x10	3 ⁹ / ₁₆	8 ¹ / ₈														
ULP212	2x12	1 ⁵ / ₈	10 ³ / ₁₆	1 ³ / ₄	18- gauge	10	16d	10	16d	2,265	2,265	2,265	1,730	1,825	1,825	1,825	1,510
ULP212-2		3 ¹ / ₈	9 ⁷ / ₁₆														
ULP212-3		4 ⁵ / ₈	8 ¹¹ / ₁₆														
ULP312	3x12	2 ⁹ / ₁₆	9 ¹¹ / ₁₆														
ULP412	4x12	3 ⁹ / ₁₆	9 ³ / ₁₆														

SI: 1 in. = 25.4 mm
 1. See notes in Section 6.3.1.



Table 3. ULP-IF Series Hangers – Allowable Gravity and Uplift Loads (lbf)¹

Part No. ULP (1, 2 and 3-ply Joists)	Joist Size (in)	Hanger Dimensions (in)			Steel Thick.	Fasteners				SP/DF-L (G=0.50)				HF/SPF (G=0.42)			
		Width, W	Height, H	Depth		Header		Joist		Floor	Roof	Roof	Uplift	Floor	Roof	Roof	Uplift
						Qty	Size	Qty	Size	1.0	1.15	1.25	1.6	1.0	1.15	1.25	1.6
ULP-IF26	2x6	1 ⁵ / ₈	5 ³ / ₈	1 ³ / ₄	18- gauge	6	16d	4	10d	830	955	1,040	745	715	825	895	640
ULP-IF26-2		3 ¹ / ₈	4 ⁵ / ₈														
ULP-IF26-3		4 ⁵ / ₈	3 ⁷ / ₈														
ULP-IF28	2x8	1 ⁵ / ₈	7 ¹ / ₈	1 ³ / ₄	18- gauge	8	16d	6	10d	1,110	1,275	1,385	930	955	1,100	1,195	805
ULP-IF28-2		3 ¹ / ₈	6 ³ / ₈														
ULP-IF28-3		4 ⁵ / ₈	5 ⁵ / ₈														
ULP-IF210	2x10	1 ⁵ / ₈	9 ¹ / ₈	1 ³ / ₄	18- gauge	10	16d	6	10d	1,385	1,590	1,730	1,115	1,195	1,375	1,490	965
ULP-IF210-2		3 ¹ / ₈	8 ³ / ₈														
ULP-IF210-3		4 ⁵ / ₈	7 ⁵ / ₈														

SI: 1 in. = 25.4 mm
1. See notes in Section 6.3.1.

Table 4. UM Series Hangers – Allowable Gravity and Uplift Loads (lbf)¹

Part No. UM (1, 2 and 3-ply Joists)	Joist Size (in)	Hanger Dimensions (in)			Steel Thick.	Fasteners				SP/DF-L (G=0.50)				HF/SPF (G=0.42)			
		Width, W	Height, H	Depth		Header		Joist		Floor	Roof	Roof	Uplift	Floor	Roof	Roof	Uplift
						Qty	Size	Qty	Size	1.0	1.15	1.25	1.6	1.0	1.15	1.25	1.6
UM26	2x6	1 ⁵ / ₈	5 ³ / ₈	2 ¹ / ₄	16- gauge	6	16d	6	16d	1,445	1,540	1,540	600	1,245	1,245	1,245	525
UM26R		2	5 ³ / ₁₆														
UM26-2		3 ¹ / ₈	4 ⁵ / ₈														
UM26-3		4 ⁵ / ₈	3 ⁷ / ₈														
UM36	3x6	2 ⁹ / ₁₆	4 ⁷ / ₈	2 ¹ / ₄	16- gauge	12	16d	6	16d	1,885	1,930	1,930	600	1,625	1,625	1,625	525
UM46	4x6	3 ⁹ / ₁₆	4 ³ / ₈														
UM46R	4x6	4	4 ³ / ₁₆														
UM28	2x8	1 ⁵ / ₈	7 ¹ / ₈														
UM28R		2	6 ¹⁵ / ₁₆														
UM28-2		3 ¹ / ₈	6 ³ / ₈														
UM28-3		4 ⁵ / ₈	5 ⁵ / ₈														
UM38	3x8	2 ⁹ / ₁₆	6 ⁵ / ₈														
UM48	4x8	3 ⁹ / ₁₆	6 ¹ / ₈														



Table 4. UM Series Hangers – Allowable Gravity and Uplift Loads (Ibf)¹

Part No. UM (1, 2 and 3-ply Joists)	Joist Size (in)	Hanger Dimensions (in)			Steel Thick.	Fasteners				SP/DF-L (G=0.50)				HF/SPF (G=0.42)			
		Width, W	Height, H	Depth		Header		Joist		Floor	Roof	Roof	Uplift	Floor	Roof	Roof	Uplift
						Qty	Size	Qty	Size	1.0	1.15	1.25	1.6	1.0	1.15	1.25	1.6
UM48R	4x8	4	5 ¹⁵ / ₁₆														
UM210	2x10	1 ⁵ / ₈	9 ¹ / ₈	2 ¹ / ₄	16- gauge	18	16d	8	16d	2,320	2,320	2,320	1,065	2,005	2,005	2,005	925
UM210R		2	8 ¹⁵ / ₁₆														
UM210-2		3 ¹ / ₈	8 ³ / ₈														
UM210-3		4 ⁵ / ₈	7 ⁵ / ₈														
UM310		3x10	2 ⁹ / ₁₆														
UM410	4x10	3 ⁹ / ₁₆	8 ¹ / ₈														
UM410R	4x10	4	7 ¹⁵ / ₁₆														
UM212	2x12	1 ⁵ / ₈	10 ³ / ₁₆	2 ¹ / ₄	16- gauge	22	16d	10	16d	1,930	1,930	1,930	1,530	1,535	1,535	1,535	1,325
UM212-2		3 ¹ / ₈	9 ⁷ / ₁₆														
UM212-3		4 ⁵ / ₈	8 ¹¹ / ₁₆														
UM312	3x12	2 ⁹ / ₁₆	9 ¹¹ / ₁₆														
UM412	4x12	3 ⁹ / ₁₆	9 ³ / ₁₆	2 ¹ / ₄	16- gauge	22	16d	10	16d	1,930	1,930	1,930	1,530	1,535	1,535	1,535	1,325
UM412R	4x12	4	9														

SI: 1 in. = 25.4 mm
 1. See notes in Section 6.3.1.



Table 5. UH Series Hangers – Allowable Gravity and Uplift Loads (Ibf)¹

Part No. UH (1, 2 and 3-ply Joists)	Joist Size (in)	Hanger Dimensions (in)			Steel Thick.	Fasteners				SP/DF-L (G=0.50)				HF/SPF (G=0.42)			
		Width, W	Height, H	Depth		Header		Joist		Floor	Roof	Roof	Uplift	Floor	Roof	Roof	Uplift
						Qty	Size	Qty	Size	1.0	1.15	1.25	1.6	1.0	1.15	1.25	1.6
UH26	2x6	1 ⁵ / ₈	5 ³ / ₈	2 ¹ / ₄	14- gauge	6	16d	6	16d	1,465	1,540	1,540	1,155	1,205	1,205	1,205	1,005
UH26-2		3 ¹ / ₈	4 ⁵ / ₈														
UH26-3		4 ⁵ / ₈	3 ⁷ / ₈														
UH36		3x6	2 ⁹ / ₁₆														
UH46	4x6	3 ⁹ / ₁₆	4 ³ / ₈														
UH28	2x8	1 ⁵ / ₈	7 ¹ / ₈	2 ¹ / ₄	14- gauge	12	16d	6	16d	1,865	1,960	1,985	1,155	1,495	1,525	1,550	1,005
UH28-2		3 ¹ / ₈	6 ³ / ₈														
UH28-3		4 ⁵ / ₈	5 ⁵ / ₈														
UH38		3x8	2 ⁹ / ₁₆														
UH48	4x8	3 ⁹ / ₁₆	6 ¹ / ₈														
UH210	2x10	1 ⁵ / ₈	9 ¹ / ₈	2 ¹ / ₄	14- gauge	18	16d	8	16d	2,265	2,375	2,425	1,565	1,780	1,850	1,890	1,365
UH210-2		3 ¹ / ₈	8 ³ / ₈														
UH210-3		4 ⁵ / ₈	7 ⁵ / ₈														
UH310		3x10	2 ⁹ / ₁₆														
UH410	4x10	3 ⁹ / ₁₆	8 ¹ / ₈														
UH212	2x12	1 ⁵ / ₈	10 ³ / ₁₆	2 ¹ / ₄	14- gauge	22	16d	10	16d	3,060	3,210	3,310	1,975	2,355	2,490	2,575	1,720
UH212-2		3 ¹ / ₈	9 ⁷ / ₁₆														
UH212-3		4 ⁵ / ₈	8 ¹¹ / ₁₆														
UH312		3x12	2 ⁹ / ₁₆														
UH412	4x12	3 ⁹ / ₁₆	9 ³ / ₁₆														

SI: 1 in. = 25.4 mm

1. See notes in Section 6.3.1.



Table 6. UH-IF Series Hangers – Allowable Gravity and Uplift Loads (lbf)¹

Part No. UH (1, 2 and 3-ply Joists)	Joist Size (in)	Hanger Dimensions (in)			Steel Thick.	Fasteners				SP/DF-L (G=0.50)				HF/SPF (G=0.42)				
		Width, W	Height, H	Depth		Header		Joist		Floor	Roof	Roof	Uplift	Floor	Roof	Roof	Uplift	
						Qty	Size	Qty	Size	1.0	1.15	1.25	1.6	1.0	1.15	1.25	1.6	
UH-IF26-2	2x6	3 ¹ / ₈	4 ⁵ / ₈	2 ¹ / ₄	14- gauge	6	16d	6	10d	865	995	1,080	1,170	750	860	935	1,015	
UH-IF26-3		4 ⁵ / ₈	3 ⁷ / ₈															
UH-IF36	3x6	2 ⁹ / ₁₆	4 ⁷ / ₈															
UH-IF46	4x6	3 ⁹ / ₁₆	4 ³ / ₈															
UH-IF28-2	2x8	3 ¹ / ₈	6 ³ / ₈	2 ¹ / ₄	14- gauge	12	16d	6	10d	1,635	1,775	1,830	1,170	1,345	1,470	1,555	1,015	
UH-IF28-3		4 ⁵ / ₈	5 ⁵ / ₈															
UH-IF38	3x8	2 ⁹ / ₁₆	6 ⁵ / ₈															
UH-IF48	4x8	3 ⁹ / ₁₆	6 ¹ / ₈															
UH-IF210-2	2x10	3 ¹ / ₈	8 ³ / ₈	2 ¹ / ₄	14- gauge	18	16d	8	10d	2,400	2,555	2,585	1,560	1,945	2,085	2,180	1,355	
UH-IF210-3		4 ⁵ / ₈	7 ⁵ / ₈															
UH-IF310	3x10	2 ⁹ / ₁₆	8 ⁵ / ₈															
UH-IF410	4x10	3 ⁹ / ₁₆	8 ¹ / ₈															
UH-IF212-2	2x12	3 ¹ / ₈	9 ⁷ / ₁₆	2 ¹ / ₄	14- gauge	22	16d	10	10d	3,170	3,335	3,335	1,950	2,540	2,695	2,800	1,690	
UH-IF212-3		4 ⁵ / ₈	8 ¹¹ / ₁₆															
UH-IF312	3x12	2 ⁹ / ₁₆	9 ¹¹ / ₁₆															
UH-IF412	4x12	3 ⁹ / ₁₆	9 ³ / ₁₆															

SI: 1 in. = 25.4 mm

1. See notes in **Section 6.3.1**.



Table 7. TSH Series Hangers (Top Mounted) – Allowable Gravity and Uplift Loads (lb^f)¹

Part No. TSH (1, 2 and 3-ply Joists)	Joist Size (in)	Hanger Dimensions (in)			Steel Thick.	Fasteners				SP (G=0.55)				DF-L (G=0.50)				HF/SPF (G=0.42)			
		Width, W	Height, H	Depth		Header		Joist		Floor	Roof	Roof	Uplift	Floor	Roof	Roof	Uplift	Floor	Roof	Roof	Uplift
						Qty	Size	Qty	Size	1.0	1.15	1.25	1.6	1.0	1.15	1.25	1.6	1.0	1.15	1.25	1.6
TSH29	2x9	1½	9 ¹¹ / ₁₆	1¾	18-gauge	4	10d	4	10d	2,345	2,695	2,875	1,155	2,025	2,325	2,530	1,070	1,505	1,735	1,885	925
TSH213	2x13	1½	13 ⁵ / ₁₆	1¾	18-gauge	4	10d	4	10d	2,435	2,800	2,985	1,000	2,110	2,420	2,635	930	1,580	1,820	1,975	805
TSH218	2x18	1½	17 ³ / ₁₆	1¾	18-gauge	4	10d	6	10d	2,520	2,900	3,090	840	2,190	2,515	2,735	785	1,650	1,900	2,065	680
TSH218-2		3	17 ¹¹ / ₁₆	1¾	16-gauge	4	16d	6	16d	4,625	4,745	4,745	2,835	3,990	4,585	4,665	2,690	2,965	3,410	3,705	2,325
TSH222-2	2x18	3	17 ¹¹ / ₁₆	1¾	16-gauge	4	16d	6	16d	4,625	4,745	4,745	2,835	3,990	4,585	4,665	2,690	2,965	3,410	3,705	2,325
TSH413	4x13	3½	22 ³ / ₁₆	1¾	16-gauge	4	16d	4	16d	3,115	3,115	3,115	1,140	2,875	2,875	2,875	1,060	1,315	1,510	1,640	920
TSH418	4x18	3½	13 ⁵ / ₁₆	1¾	18-gauge	4	10d	6	10d	3,800	3,800	3,800	1,785	3,525	3,525	3,525	1,650	2,345	2,555	2,620	1,430
TSH422	4x22	3½	17 ¹ / ₂	1¾	16-gauge	4	16d	6	16d	4,485	4,485	4,485	2,425	4,170	4,170	4,170	2,240	3,375	3,595	3,595	1,935
TSH422-2	4x22	7¼	22	2½	16-gauge	4	16d	6	16d	4,055	4,055	4,055	2,390	3,830	3,830	3,830	2,210	3,315	3,315	3,315	1,910
TSH426	4x26	3½	26	1¾	14-gauge	4	16d	6	16d	4,645	4,645	4,645	2,420	4,350	4,350	4,350	2,245	3,375	3,765	3,765	1,955
TSH426-2	4x26	7¼	22 ¹¹ / ₁₆	2½	14-gauge	4	16d	6	16d	4,055	4,055	4,055	2,390	3,830	3,830	3,830	2,210	3,315	3,315	3,315	1,910

SI: 1 in. = 25.4 mm

1. See notes in **Section 6.3.1.**



Table 8. TSH Series Hangers (Face Mounted) – Allowable Gravity and Uplift Loads (lbf)¹

Part No. TSH (1, 2 and 3-ply Joists)	Joist Size (in)	Hanger Dimensions (in)			Steel Thick.	Fasteners				SP (G=0.55)				DF-L (G=0.50)				HF/SPF (G=0.42)			
		Width, W	Height, H	Depth		Header		Joist		Floor	Roof	Roof	Uplift	Floor	Roof	Roof	Uplift	Floor	Roof	Roof	Uplift
						Qty	Size	Qty	Size	1.0	1.15	1.25	1.6	1.0	1.15	1.25	1.6	1.0	1.15	1.25	1.6
TSH29	2x9	1 1/2	9 11/16	1 3/4	18-gauge	16	10d	4	10d	2,115	2,115	2,115	1,155	1,910	1,910	1,910	1,070	1,455	1,455	1,455	925
TSH213	2x13	1 1/2	13 5/16	1 3/4	18-gauge	14	10d	4	10d	2,115	2,115	2,115	1,005	1,930	1,930	1,930	930	1,480	1,570	1,570	805
TSH218	2x18	1 1/2	17 3/16	1 3/4	18-gauge	18	10d	4	10d	2,115	2,115	2,115	850	1,950	1,950	1,950	790	1,505	1,680	1,680	685
TSH218-2		3	17 11/16	1 3/4	16-gauge	22	16d	6	16d	4,100	4,715	5,120	2,835	3,790	4,355	4,735	2,710	2,965	3,410	3,705	2,335
TSH222-2	2x18	3	17 11/16	1 3/4	16-gauge	22	16d	6	16d	4,100	4,715	5,120	2,835	3,790	4,355	4,735	2,710	2,965	3,410	3,705	2,335
TSH413	4x13	3 1/2	22 3/16	1 3/4	16-gauge	14	16d	4	16d	2,160	2,485	2,700	1,145	1,995	2,295	2,495	1,065	1,720	1,980	2,150	925
TSH418	4x18	3 1/2	13 5/16	1 3/4	18-gauge	22	10d	6	10d	3,275	3,770	4,095	1,950	3,030	3,480	3,785	1,800	2,620	3,010	3,275	1,555
TSH422	4x22	3 1/2	17 1/2	1 3/4	16-gauge	22	16d	6	16d	4,100	4,715	5,120	2,440	3,790	4,355	4,735	2,255	3,275	3,765	4,095	1,945
TSH422-2	4x22	7 1/4	22	2 1/2	16-gauge	30	16d	6	16d	5,190	5,190	5,190	2,400	4,800	4,800	4,800	2,220	4,150	4,150	4,150	1,920
TSH426	4x26	3 1/2	26	1 3/4	14-gauge	30	16d	6	16d	4,990	4,990	4,990	2,435	4,555	4,615	4,615	2,260	3,375	3,880	3,990	1,970
TSH426-2	4x26	7 1/4	22 11/16	2 1/2	14-gauge	38	16d	6	16d	5,190	5,190	5,190	2,400	4,800	4,800	4,800	2,220	4,150	4,150	4,150	1,920

SI: 1 in. = 25.4 mm

1. See notes in Section 6.3.1.

Table 9. TFLP & TFH Series Hangers – Allowable Gravity and Uplift Loads (lbf)¹

Part No. TFLP	Joist Size (in)	Hanger Dimensions (in)				Steel Thick.	Fasteners				SP/DF-L (G=0.50)				HF/SPF (G=0.42)			
		Width, W	Height, H	Depth	Top Flange, TF		Header		Joist		Floor	Roof	Roof	Uplift	Floor	Roof	Roof	Uplift
							Qty	Size	Qty	Size	1.0	1.15	1.25	1.6	1.0	1.15	1.25	1.6
TFLP26	2x6	1 9/16	5 3/8	1 1/2	1 5/16	18-gauge	6	16d	2	10d x 1 1/2	1,245	1,245	1,245	230	945	945	945	165
TFLP28	2x8		7 1/4	1 1/2	1 5/16						1,245	1,245	1,245	230	945	945	945	225
TFH210	2x10		9 3/16	2	17 1/16	14-gauge	8	4	4	10d x 1 1/2	1,535	1,535	1,535	380	1,165	1,165	1,165	285
TFH212	2x12		11 1/8								1,535	1,535	1,535	380	1,165	1,165	1,165	285
TFH214	2x14		13 1/8								1,535	1,535	1,535	380	1,165	1,165	1,165	285

SI: 1 in. = 25.4 mm

2. See notes in Section 6.3.1.



- 6.4 Where the application falls outside of the performance evaluation, conditions of use and/or installation requirements set forth herein, alternative techniques shall be permitted in accordance with accepted engineering practice and experience. This includes but is not limited to the following areas of engineering: mechanics or materials, structural, building science, and fire science.

7 Certified Performance^{xxiii}

- 7.1 All construction methods shall conform to accepted engineering practices to ensure durable, livable, and safe construction and shall demonstrate acceptable workmanship reflecting journeyman quality of work of the various trades.^{xxiv}
- 7.2 The strength and rigidity of the component parts and/or the integrated structure shall be determined by engineering analysis or by suitable load tests to simulate the actual loads and conditions of application that occur.^{xxv}

8 Regulatory Evaluation and Accepted Engineering Practice

- 8.1 QuickTie U-Hanger Series comply with the following legislatively adopted regulations and/or accepted engineering practice for the following reasons:
- 8.1.1 QuickTie U-Hanger Series Face Mount and Top Flange Mount Joist Hangers were evaluated for the following:
- 8.1.1.1 Structural performance of connectors under uplift and gravity load conditions.
- 8.1.1.2 Performance for use in buildings of light-frame construction in accordance with the codes listed in **Section 4**.
- 8.2 Any building code, regulation, and/or accepted engineering evaluations (i.e., research reports, Duly Authenticated Reports, etc.) that are conducted for this Listing were performed by DrJ Engineering, LLC (DrJ), an ISO/IEC 17065 accredited certification body and a professional engineering company operated by RDP/approved sources. DrJ is qualified^{xxvi} to practice product and regulatory compliance services within its scope of accreditation and engineering expertise, respectively.
- 8.3 Engineering evaluations are conducted with DrJ's ANAB accredited ICS code scope of expertise, which are also its areas of professional engineering competence.
- 8.4 Any regulation specific issues not addressed in this section are outside the scope of this report.

9 Installation

- 9.1 Installation shall comply with the approved construction documents, the manufacturer installation instructions, this report and the applicable building code.
- 9.2 In the event of a conflict between the manufacturer installation instructions and this report, the more restrictive shall govern.
- 9.3 *Installation Procedure*
- 9.3.1 Hangers shall be attached to wood members with the appropriate quantity and size of fasteners, as shown in **Table 1** through **Table 9**.
- 9.3.2 A copy of the manufacturer published installation instructions shall be available at all times on the jobsite during installation.
- 9.3.3 Installation examples are shown in **Figure 5**, **Figure 6**, **Figure 7** and **Figure 8**.

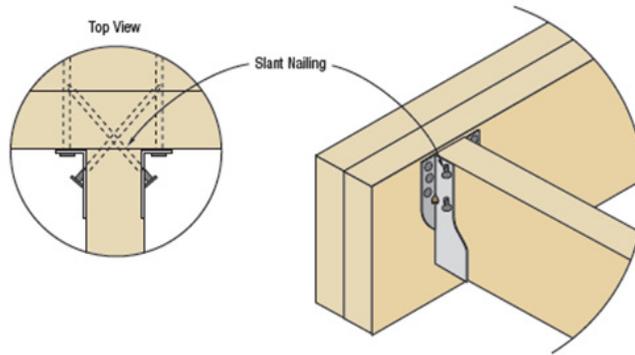


Figure 5. Installation View of U Hangers

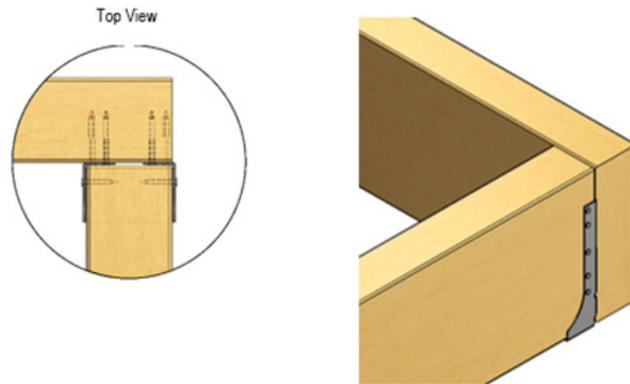


Figure 6. Installation Views of Inverted Flange (IF) U Hangers

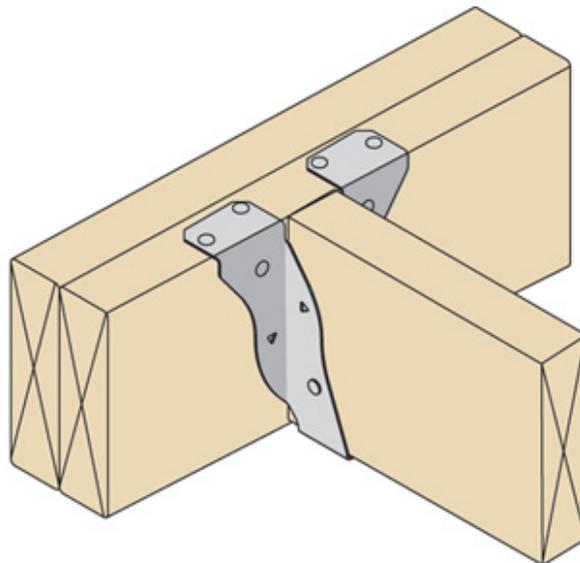


Figure 7. Installation View of Top Flange (TFLP & TFH) Hangers

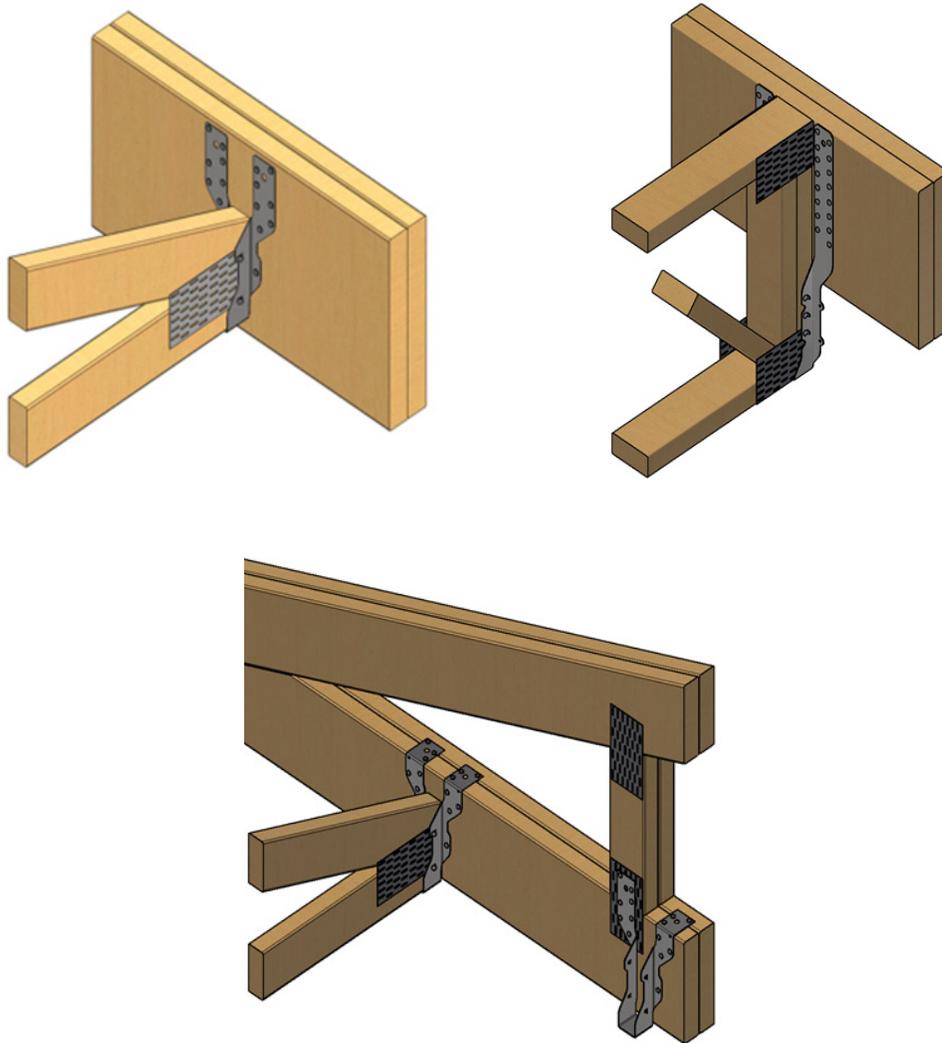


Figure 8. Installation View of Top and Face Mounted Flange (TSH) Hangers



10 Substantiating Data

- 10.1 Testing has been performed under the supervision of a professional engineer and/or under the requirements of ISO/IEC 17025 as follows:
 - 10.1.1 Bending yield testing in accordance with ASTM F1575
 - 10.1.2 Tensile strength testing in accordance with ASTM A370
 - 10.1.3 Gravity and uplift load testing in accordance with ASTM D7147
- 10.2 Information contained herein may include the result of testing and/or data analysis by sources that are approved agencies, approved sources, and/or RDPs. Accuracy of external test data and resulting analysis is relied upon.
- 10.3 Where pertinent, testing and/or engineering analysis are based upon provisions that have been codified into law through state or local adoption of regulations and standards. The developers of these regulations and standards are responsible for the reliability of published content. DrJ's engineering practice may use a regulation-adopted provision as the control. A regulation-endorsed control versus a simulation of the conditions of application to occur establishes a new material as being equivalent to the regulatory provision in terms of quality, strength, effectiveness, fire resistance, durability, and safety.
- 10.4 The accuracy of the provisions provided herein may be reliant upon the published properties of raw materials, which are defined by the grade mark, grade stamp, mill certificate, or Duly Authenticated Reports from approved agencies and/or approved sources provided by the supplier. These are presumed to be minimum properties and relied upon to be accurate. The reliability of DrJ's engineering practice, as contained in this Duly Authenticated Report, may be dependent upon published design properties by others.
- 10.5 Testing and engineering analysis: The strength, rigidity, and/or general performance of component parts and/or the integrated structure are determined by suitable tests that simulate the actual conditions of application that occur and/or by accepted engineering practice and experience.^{xxvii}
- 10.6 Where additional condition of use and/or regulatory compliance information is required, please search for QuickTie U-Hanger Series on the DrJ Certification website.

11 Findings

- 11.1 As outlined in **Section 6**, QuickTie U-Hanger Series have performance characteristics that were tested and/or meet applicable regulations and are suitable for use pursuant to its specified purpose.
- 11.2 When used and installed in accordance with this Duly Authenticated Report and the manufacturer installation instructions, QuickTie U-Hanger Series shall be approved for the following applications:
 - 11.2.1 Use as described in this report conform to the codes listed in **Section 4**.
 - 11.2.2 Where the design values listed in **Table 1** through **Table 9** meet the requirements of the building design.
- 11.3 Unless exempt by state statute, when QuickTie U-Hanger Series are to be used as a structural and/or building envelope component in the design of a specific building, the design shall be performed by an RDP.
- 11.4 Any application specific issues not addressed herein can be engineered by an RDP. Assistance with engineering is available from QuickTie™ Products, Inc.
- 11.5 IBC Section 104.11 (IRC Section R104.11 and IFC Section 104.10^{xxviii} are similar) in pertinent part states:

104.11 Alternative materials, design and methods of construction and equipment. The provisions of this code are not intended to prevent the installation of any material or to prohibit any design or method of construction not specifically prescribed by this code. Where the alternative material, design or method of construction is not approved, the building official shall respond in writing, stating the reasons the alternative was not approved.



- 11.6 **Approved:**^{xxix} Building regulations require that the building official shall accept Duly Authenticated Reports.^{xxx}
- 11.6.1 An approved agency is “approved” when it is ANAB ISO/IEC 17065 accredited.
- 11.6.2 An approved source is “approved” when an RDP is properly licensed to transact engineering commerce.
- 11.6.3 Federal law, Title 18 US Code Section 242, requires that where the alternative product, material, service, design, assembly, and/or method of construction is not approved, the building official shall respond in writing, stating the reasons why the alternative was not approved. Denial without written reason deprives a protected right to free and fair competition in the marketplace.
- 11.7 DrJ is a licensed engineering company, employs licensed RDPs and is an ANAB-Accredited Product Certification Body – Accreditation #1131.
- 11.8 Through the IAF Multilateral Agreements (MLA), this Duly Authenticated Report can be used to obtain product approval in any jurisdiction or country because all ANAB ISO/IEC 17065 Duly Authenticated Reports are equivalent.^{xxxi}

12 Conditions of Use

- 12.1 Material properties shall not fall outside the boundaries defined in **Section 6**.
- 12.2 As defined in **Section 6**, where material and/or engineering mechanics properties are created for load resisting design purposes, the resistance to the applied load shall not exceed the ability of the defined properties to resist those loads using the principles of accepted engineering practice.
- 12.3 Calculations showing compliance with this report must be submitted to the code official. The calculations must be prepared by an RDP.
- 12.4 When required by adopted legislation and enforced by the building official, also known as the authority having jurisdiction (AHJ) in which the project is to be constructed:
- 12.4.1 Any calculations incorporated into the construction documents shall conform to accepted engineering practice and, when prepared by an approved source, shall be approved when signed and sealed.
- 12.4.2 This report and the installation instructions shall be submitted at the time of permit application.
- 12.4.3 These innovative products have an internal quality control program and a third-party quality assurance program.
- 12.4.4 At a minimum, these innovative products shall be installed per **Section 9** of this report.
- 12.4.5 The review of this report by the AHJ shall comply with IBC Section 104 and IBC Section 105.4.
- 12.4.6 These innovative products have an internal quality control program and a third party quality assurance program in accordance with IBC Section 104.4, IBC Section 110.4, IBC Section 1703, IRC Section R104.4, and IRC Section R109.2.
- 12.4.7 The application of these innovative products in the context of this report is dependent upon the accuracy of the construction documents, implementation of installation instructions, inspection as required by IBC Section 110.3, IRC Section R109.2, and any other regulatory requirements that may apply.
- 12.5 The approval of this report by the AHJ shall comply with IBC Section 1707.1, where legislation states in part, “*the building official shall accept duly authenticated reports from approved agencies in respect to the quality and manner of use of new material or assemblies as provided for in Section 104.11,” all of IBC Section 104, and IBC Section 105.4.*
- 12.6 Design loads shall be determined in accordance with the regulations adopted by the jurisdiction in which the project is to be constructed and/or by the building designer (i.e., owner or RDP).
- 12.7 The actual design, suitability, and use of this report for any particular building, is the responsibility of the owner or the authorized agent of the owner.



13 Identification

- 13.1 The innovative products listed in **Section 1.1** are identified by a label on the board or packaging material bearing the manufacturer name, product name, this report number, and other information to confirm code compliance.
- 13.2 Additional technical information can be found at www.quicktieproducts.com.

14 Review Schedule

- 14.1 This report is subject to periodic review and revision. For the latest version, visit drjcertification.org.
- 14.2 For information on the status of this report, please contact [DrJ Certification](#).

15 Approved for Use Pursuant to U.S. and International Legislation Defined in Appendix A

- 15.1 QuickTie U-Hanger Series are included in this report published by an approved agency that is concerned with evaluation of products or services, maintains periodic inspection of the production of listed materials or periodic evaluation of services. This report states either that the material, product, or service meets recognized standards or has been tested and found suitable for a specified purpose. This report meets the legislative intent and definition of being acceptable to the AHJ.



Appendix A

1 Legislation that Authorizes AHJ Approval

- 1.1 **Fair Competition:** State legislatures have adopted Federal regulations for the examination and approval of building code referenced and alternative products, materials, designs, services, assemblies, and/or methods of construction that:
 - 1.1.1 Advance innovation,
 - 1.1.2 Promote competition so all businesses have the opportunity to compete on price and quality in an open market on a level playing field unhampered by anticompetitive constraints, and
 - 1.1.3 Benefit consumers through lower prices, better quality, and greater choice.
- 1.2 **Adopted Legislation:** The following local, state, and federal regulations affirmatively authorize these innovative products to be approved by AHJs, delegates of building departments, and/or delegates of an agency of the federal government:
 - 1.2.1 Interstate commerce is governed by the Federal Department of Justice to encourage the use of innovative products, materials, designs, services, assemblies, and/or methods of construction. The goal is to “*protect economic freedom and opportunity by promoting free and fair competition in the marketplace.*”
 - 1.2.2 Title 18 US Code Section 242 affirms and regulates the right of individuals and businesses to freely and fairly have new products, materials, designs, services, assemblies, and/or methods of construction approved for use in commerce. Disapproval of alternatives shall be based upon non-conformance with respect to specific provisions of adopted legislation and shall be provided in writing stating the reasons why the alternative was not approved, with reference to the specific legislation violated.
 - 1.2.3 The federal government and each state have a public records act. In addition, each state also has legislation that mimics the federal Defend Trade Secrets Act 2016 (DTSA),^{xxxii} where providing test reports, engineering analysis and/or other related IP/TS is subject to prison of not more than ten years^{xxxiii} and/or a \$5,000,000 fine or 3 times the value of^{xxxiv} the Intellectual Property (IP) and Trade Secrets (TS).
 - 1.2.3.1 Compliance with public records and trade secret legislation requires approval through the use of Listings, certified reports, Technical Evaluation Reports, Duly Authenticated Reports, and/or research reports prepared by approved agencies and/or approved sources.
 - 1.2.4 For new materials^{xxxv} that are not specifically provided for in any regulation, the design strengths and permissible stresses shall be established by tests, where suitable load tests simulate the actual loads and conditions of application that occur.
 - 1.2.5 The design strengths and permissible stresses of any structural material shall conform to the specifications and methods of design using accepted engineering practice.^{xxxvi}
 - 1.2.6 The commerce of approved sources (i.e., registered PEs) is regulated by professional engineering legislation. Professional engineering commerce shall always be approved by AHJs, except where there is evidence provided in writing, that specific legislation have been violated by an individual registered PE.
 - 1.2.7 The AHJ shall accept Duly Authenticated Reports from approved agencies in respect to the quality and manner of use of new materials or assemblies as provided for in IBC Section 104.11.^{xxxvii}



- 1.3 **Approved^{xxxviii} by Los Angeles:** The Los Angeles Municipal Code (LAMC) states in pertinent part that the provisions of LAMC are not intended to prevent the use of any material, device, or method of construction not specifically prescribed by LAMC. The Department shall use Part III, Recognized Standards in addition to Part II, Uniform Building Code Standards of Division 35, Article 1, Chapter IX of the LAMC in evaluation of products for approval where such standard exists for the product or the material and may use other approved standards that apply. Whenever tests or certificates of any material or fabricated assembly are required by Chapter IX of the LAMC, such tests or certification shall be made by a testing agency approved by the Superintendent of Building to conduct such tests or provide such certifications. The testing agency shall publish the scope and limitation(s) of the listed material or fabricated assembly.^{xxxix} The Superintendent of Building Approved Testing Agency Roster is provided by the Los Angeles Department of Building and Safety (LADBS). The Center for Building Innovation (CBI) Certificate of Approval License is TA24945. Tests and certifications found in a DrJ Listing are LAMC approved. In addition, the Superintendent of Building shall accept Duly Authenticated Reports from approved agencies in respect to the quality and manner of use of new materials or assemblies as provided for in the California Building Code (CBC) Section 1707.1.^{xl}
- 1.4 **Approved by Chicago:** The Municipal Code of Chicago (MCC) states in pertinent part that an Approved Agency is a Nationally Recognized Testing Laboratory (NRTL) acting within its recognized scope and/or a certification body accredited by the American National Standards Institute (ANSI) acting within its accredited scope. Construction materials and test procedures shall conform to the applicable standards listed in the MCC. Sufficient technical data shall be submitted to the building official to substantiate the proposed use of any product, material, service, design, assembly, and/or method of construction not specifically provided for in the MCC. This technical data shall consist of research reports from approved sources (i.e., MCC defined Approved Agencies).
- 1.5 **Approved by New York City:** The 2022 NYC Building Code (NYCBC) states in part that an approved agency shall be deemed^{xli} an approved testing agency via ISO/IEC 17025 accreditation, an approved inspection agency via ISO/IEC 17020 accreditation, and an approved product evaluation agency via ISO/IEC 17065 accreditation. Accrediting agencies, other than federal agencies, must be members of an internationally recognized cooperation of laboratory and inspection accreditation bodies subject to a mutual recognition agreement^{xlii} (i.e., ANAB, International Accreditation Forum [IAF], etc.).
- 1.6 **Approved by Florida:** Statewide approval of products, methods, or systems of construction shall be approved, without further evaluation by:
- 1.6.1 A certification mark or listing of an approved certification agency,
 - 1.6.2 A test report from an approved testing laboratory,
 - 1.6.3 A product evaluation report based upon testing or comparative or rational analysis, or a combination thereof, from an approved product evaluation entity, or
 - 1.6.4 A product evaluation report based upon testing, comparative or rational analysis, or a combination thereof, developed, signed and sealed by a professional engineer or architect, licensed in Florida.
 - 1.6.5 For local product approval, products or systems of construction shall demonstrate compliance with the structural wind load requirements of the Florida Building Code (FBC) through one of the following methods:
 - 1.6.5.1 A certification mark, listing or label from a commission-approved certification agency indicating that the product complies with the code,
 - 1.6.5.2 A test report from a commission-approved testing laboratory indicating that the product tested complies with the code,
 - 1.6.5.3 A product-evaluation report based upon testing, comparative or rational analysis, or a combination thereof, from a commission-approved product evaluation entity which indicates that the product evaluated complies with the code,



- 1.6.5.4 A product-evaluation report or certification based upon testing or comparative or rational analysis, or a combination thereof, developed and signed and sealed by a Florida professional engineer or Florida registered architect, which indicates that the product complies with the code, or
- 1.6.5.5 A statewide product approval issued by the Florida Building Commission.
- 1.6.6 The [Florida Department of Business and Professional Regulation \(DBPR\)](#) website provides a listing of companies certified as a [Product Evaluation Agency](#) (i.e., EVLMiami 13692), a [Product Certification Agency](#) (i.e., CER10642), and as a [Florida Registered Engineer](#) (i.e., ANE13741).
- 1.7 **Approved by Miami-Dade County (i.e., Notice of Acceptance [NOA]):** A Florida statewide approval is an NOA. An NOA is a Florida local product approval. By Florida law, Miami-Dade County shall accept the statewide and local Florida Product Approval as provided for in Florida legislation [553.842](#) and [553.8425](#).
- 1.8 **Approved by New Jersey:** Pursuant to the 2018 Building Code of New Jersey in [IBC Section 1707.1 General](#),^{xliii} it states: “*In the absence of approved rules or other approved standards, the building official shall accept duly authenticated reports from [approved agencies](#) in respect to the quality and manner of use of new materials or assemblies as provided for in the administrative provisions of the Uniform Construction Code (N.J.A.C. 5:23)*”.^{xliiv} Furthermore N.J.A.C 5:23-3.7 states: “*Municipal approvals of alternative materials, equipment, or methods of construction.*”
- 1.8.1 **Approvals:** Alternative materials, equipment, or methods of construction shall be approved by the appropriate subcode official provided the proposed design is satisfactory and that the materials, equipment, or methods of construction are suitable for the intended use and are at least the equivalent in quality, strength, effectiveness, fire resistance, durability, and safety of those conforming with the requirements of the regulations.
- 1.8.1.1 A field evaluation label and report or letter issued by a nationally recognized testing laboratory verifying that the specific material, equipment, or method of construction meets the identified standards or has been tested and found to be suitable for the intended use, shall be accepted by the appropriate subcode official as meeting the requirements of the above.
- 1.8.1.2 Reports of engineering findings issued by nationally recognized evaluation service programs such as but not limited to, the Building Officials and Code Administrators (BOCA), the International Conference of Building Officials (ICBO), the Southern Building Code Congress International (SBCCI), the International Code Council (ICC), and the National Evaluation Service, Inc., shall be accepted by the appropriate subcode official as meeting the requirements of the above.
- 1.8.2 The [New Jersey Department of Community Affairs](#) has confirmed that technical evaluation reports, from any accredited entity listed by [ANAB](#), meets the requirements of item the previous paragraph, given that the listed entities are no longer in existence and/or do not provide “*reports of engineering findings.*”
- 1.9 **Approved by the Code of Federal Regulations Manufactured Home Construction and Safety Standards:** Pursuant to Title 24, Subtitle B, Chapter XX, [Part 3282.14](#)^{xlv} and [Part 3280](#),^{xlvi} the Department encourages innovation and the use of new technology in manufactured homes. The design and construction of a manufactured home shall conform to the provisions of Part 3282 and Part 3280 where key approval provisions in mandatory language follow:
- 1.9.1 “*All construction methods shall be in conformance with accepted engineering practices.*”
- 1.9.2 “*The strength and rigidity of the component parts and/or the integrated structure shall be determined by engineering analysis or by suitable load tests to simulate the actual loads and conditions of application that occur.*”
- 1.9.3 “*The design stresses of all materials shall conform to accepted engineering practice.*”



- 1.10 **Approval by US, Local and State Jurisdictions in General:** In all other local and state jurisdictions, the adopted building code legislation states in pertinent part that:
- 1.10.1 For new materials that are not specifically provided for in this code, the design strengths and permissible stresses shall be established by tests.^{xlvii}
 - 1.10.2 For innovative alternatives and/or methods of construction, the building official shall accept Duly Authenticated Reports from approved agencies with respect to the quality and manner of use of new materials or assemblies.^{xlviii}
 - 1.10.2.1 An approved agency is “approved” when it is ANAB ISO/IEC 17065 accredited. DrJ Engineering, LLC (DrJ) is in the ANAB directory.
 - 1.10.2.2 An approved source is “approved” when an RDP is properly licensed to transact engineering commerce. The regulatory authority governing approved sources is the state legislature via its professional engineering regulations.^{xlix}
 - 1.10.3 The design strengths and permissible stresses of any structural material...shall conform to the specifications and methods of design of accepted engineering practice performed by an approved source.^l
- 1.11 **Approval by International Jurisdictions:** The USMCA and GATT agreements provide for approval of innovative materials, designs, services, and/or methods of construction through the Agreement on Technical Barriers to Trade and the IAF Multilateral Recognition Arrangement (MLA), where these agreements:
- 1.11.1 State that conformity assessment procedures (i.e., ISO/IEC 17020, 17025, 17065, etc.) are prepared, adopted, and applied so as to grant access for suppliers of like products originating in the territories of other Members under conditions no less favourable than those accorded to suppliers of like products of national origin or originating in any other country, in a comparable situation.
 - 1.11.2 **Approved:** The purpose of the MLA is to ensure mutual recognition of accredited certification and validation/verification statements between signatories to the MLA and subsequently, acceptance of accredited certification and validation/verification statements in many markets based on one accreditation for the timely approval of innovative materials, designs, services, and/or methods of construction.
 - 1.11.3 ANAB is an IAF-MLA signatory where recognition of certificates, validation, and verification statements issued by conformity assessment bodies accredited by all other signatories of the IAF MLA, with the appropriate scope, shall be approved.^{li}
 - 1.11.4 Therefore, all ANAB ISO/IEC 17065 Duly Authenticated Reports are approval equivalent.^{lii}
- 1.12 Approval equity is a fundamental commercial and legal principle.^{liii}



Issue Date: July 1, 2021
Subject to Renewal: July 1, 2025

FBC Supplement to Report Number 1811-03

REPORT HOLDER: QuickTie™ Products, Inc.

1 Evaluation Subject

- 1.1 QuickTie U-Hanger Series:
 - 1.1.1 UL Series – 20-gauge
 - 1.1.2 ULP & ULP-IF (Inverted Flange) Series – 18-gauge
 - 1.1.3 UM Series – 16-gauge
 - 1.1.4 UH & UH-IF (Inverted Flange) Series – 14-gauge
 - 1.1.5 TSH Series- 14-gauge, 16-gauge and 18-gauge
 - 1.1.6 TFLP (Top Flange) Series – 18-gauge
 - 1.1.7 TFH (Top Flange) Series – 14-gauge

2 Purpose and Scope

- 2.1 Purpose
 - 2.1.1 The purpose of this Report Supplement is to show QuickTie U-Hanger Series, recognized in Report Number 1811-03, have also been evaluated for compliance with the codes listed below as adopted by the Florida Building Commission.
- 2.2 *Applicable Code Editions*
 - 2.2.1 *FBC-B—20, 23: Florida Building Code – Building (FL 3557)*
 - 2.2.2 *FBC-R—20, 23: Florida Building Code – Residential (FL 3557)*

3 Conclusions

- 3.1 QuickTie U-Hanger Series, described in Report Number 1811-03, comply with the FBC-B and FBC-R and are subject to the conditions of use described in this supplement.
- 3.2 Where there are variations between the IBC and IRC and the FBC-B and FBC-R applicable to this report, they are listed here:
 - 3.2.1 FBC-B Section 104.4 and Section 110.4 are reserved.
 - 3.2.2 FBC-R Section R104 and Section R109 are reserved.
 - 3.2.3 FBC-B Section 2304.10.3 replaces IBC Section 2304.10.4.
 - 3.2.4 FBC-B Section 2303.5 replaces IBC Section 2303.5.
 - 3.2.5 FBC-R Section R301.1.3 replaces IRC Section R301.1.3.



4 Conditions of Use

4.1 QuickTie U-Hanger Series, described in Report Number 1811-03, must comply with all of the following conditions:

- 4.1.1 All applicable sections in Report Number 1811-03.
- 4.1.2 The design, installation, and inspections are in accordance with additional requirements of FBC-B Chapter 16 and Chapter 17, as applicable.



Notes

- i For more information, visit drjcertification.org or call us at 608-310-6748.
- ii <https://up.codes/viewer/wyoming/ibc-2021/chapter/17/special-inspections-and-tests#1702>
- iii Alternative Materials, Design and Methods of Construction and Equipment: The provisions of any regulation code are not intended to prevent the installation of any material or to prohibit any design or method of construction not specifically prescribed by a regulation. Please review <https://www.justice.gov/atr/mission> and <https://up.codes/viewer/colorado/ibc-2021/chapter/1/scope-and-administration#104.11>
- iv <https://up.codes/viewer/wyoming/ibc-2021/chapter/17/special-inspections-and-tests#1706>:-:text=the%20design%20strengths%20and%20permissible%20stresses%20shall%20be%20established%20by%20tests%20as
- v The design strengths and permissible stresses of any structural material shall conform to the specifications and methods of design of accepted engineering practice. <https://up.codes/viewer/wyoming/ibc-2021/chapter/17/special-inspections-and-tests#1706>:-:text=shall%20conform%20to%20the%20specifications%20and%20methods%20of%20design%20of%20accepted%20engineering%20practice
- vi <https://up.codes/viewer/wyoming/ibc-2021/chapter/17/special-inspections-and-tests#1707.1>:-:text=the%20building%20official%20shall%20accept%20duly%20authenticated%20reports%20from%20approved%20agencies
- vii <https://up.codes/viewer/wyoming/ibc-2021/chapter/17/special-inspections-and-tests#1703.4.2>
- viii https://up.codes/viewer/wyoming/ibc-2021/chapter/2/definitions#approved_agency
- ix https://up.codes/viewer/wyoming/ibc-2021/chapter/2/definitions#approved_source
- x <https://www.law.cornell.edu/uscode/text/18/1832> (b) Any organization that commits any offense described in subsection (a) shall be fined not more than the greater of \$5,000,000 or 3 times the value of the stolen trade secret to the organization, including expenses for research and design and other costs of reproducing the trade secret that the organization has thereby avoided. The federal government and each state have a public records act. To follow DTSA and comply state public records and trade secret legislation requires approval through ANAB ISO/IEC 17065 accredited certification bodies or approved sources. For more information, please review this website: [Intellectual Property and Trade Secrets](#).
- xi <https://www.nspe.org/resources/issues-and-advocacy/professional-policies-and-position-statements/regulation-professional> AND <https://apassociation.org/list-of-engineering-boards-in-each-state-archive/>
- xii <https://www.cbiteest.com/accreditation/>
- xiii <https://up.codes/viewer/colorado/ibc-2021/chapter/1/scope-and-administration#104>:-:text=to%20enforce%20the%20provisions%20of%20this%20code
- xiv <https://up.codes/viewer/colorado/ibc-2021/chapter/1/scope-and-administration#104.11>:-:text=Where%20the%20alternative%20material%20design%20or%20method%20of%20construction%20is%20not%20approved%20the%20building%20official%20shall%20respond%20in%20writing%20stating%20the%20reasons%20why%20the%20alternative%20was%20not%20approved AND <https://up.codes/viewer/colorado/ibc-2021/chapter/1/scope-and-administration#105.3.1>:-:text=If%20the%20application%20or%20the%20construction%20documents%20do%20not%20conform%20to%20the%20requirements%20of%20pertinent%20laws%20the%20building%20official%20shall%20reject%20such%20application%20in%20writing%20stating%20the%20reasons%20therefore
- xv <https://up.codes/viewer/colorado/ibc-2021/chapter/17/special-inspections-and-tests#1707.1>:-:text=the%20building%20official%20shall%20accept%20duly%20authenticated%20reports%20from%20approved%20agencies%20in%20respect%20to%20the%20quality%20and%20manner%20of%20use%20of%20new%20materials%20or%20assemblies%20as%20provided%20for%20in%20Section%20104.11
- xvi <https://iaf.eu/en/about-iaf>:-:text=it%20is%20required%20to%20recognise%20certificates%20and%20validation%20and%20verification%20statements%20issued%20by%20conformity%20assessment%20bodies%20accredited%20by%20all%20other%20signatories%20of%20the%20IAF%20MLA%20with%20the%20appropriate%20scope
- xvii True for all ANAB accredited product evaluation agencies and all International Trade Agreements.
- xviii <https://www.justice.gov/crt/deprivation-rights-under-color-law> AND <https://www.justice.gov/atr/mission>
- xix Unless otherwise noted, all references in this Listing are from the 2021 version of the codes and the standards referenced therein. This material, product, design, service and/or method of construction also complies with the 2000-2021 versions of the referenced codes and the standards referenced therein.
- xx All references to the FBC-B and FBC-R are the same as the 2021 IBC and 2021 IRC unless otherwise noted in the Florida Supplement at the end of this report.
- xxi <https://www.ecfr.gov/current/title-24/subtitle-B/chapter-XX/part-3280#p-3280.2>(Listed%20or%20certified); <https://up.codes/viewer/colorado/ibc-2021/chapter/2/definitions#labeled>
- xxii 2018 IBC Section 2304.10.3
- xxiii <https://up.codes/viewer/colorado/ibc-2021/chapter/17/special-inspections-and-tests#1703.4>
- xxiv <https://www.ecfr.gov/current/title-24/subtitle-B/chapter-XX/part-3280#>:-:text=All%20construction%20methods%20shall%20be%20in%20conformance%20with%20accepted%20engineering%20practices%20to%20insure%20durable%20livable%20and%20safe%20housing%20and%20shall%20demonstrate%20acceptable%20workmanship%20reflecting%20journeyman%20quality%20of%20work%20of%20the%20various%20trades
- xxv <https://www.ecfr.gov/current/title-24/subtitle-B/chapter-XX/part-3280#>:-:text=The%20strength%20and%20rigidity%20of%20the%20component%20parts%20and/or%20the%20integrated%20structure%20shall%20be%20determined%20by%20engineering%20analysis%20or%20by%20suitable%20load%20tests%20to%20simulate%20the%20actual%20loads%20and%20conditions%20of%20application%20that%20occur
- xxvi Qualification is performed by a legislatively defined Accreditation Body. ANSI National Accreditation Board (ANAB) is the largest independent accreditation body in North America and provides services in more than 75 countries. DrJ is an ANAB accredited product certification body.
- xxvii See Code of Federal Regulations (CFR) Title 24 Subtitle B Chapter XX Part 3280 for definition.
- xxviii 2018 IFC Section 104.9
- xxix Approved is an adjective that modifies the noun after it. For example, Approved Agency means that the Agency is accepted officially as being suitable in a particular situation. This example conforms to IBC/IRC/IFC Section 201.4 where the building code authorizes sentences to have an ordinarily accepted meaning such as the context implies.



- xxx <https://up.codes/viewer/wyoming/ibc-2021/chapter/17/special-inspections-and-tests#1707.1>
- xxxi Multilateral approval is true for all ANAB accredited product evaluation agencies and all International Trade Agreements.
- xxxii <http://www.drjengineering.org/AppendixC> AND <https://www.drjcertification.org/comell-2016-protection-trade-secrets>
- xxxiii <https://www.law.cornell.edu/uscode/text/18/1832#:~:text=imprisoned%20not%20more%20than%2010%20years>
- xxxiv <https://www.law.cornell.edu/uscode/text/18/1832#:~:text=Any%20organization%20that,has%20thereby%20avoided>
- xxxv <https://up.codes/viewer/wyoming/ibc-2021/chapter/17/special-inspections-and-tests#1706.2>
- xxxvi IBC 2021, Section 1706.1 Conformance to Standards
- xxxvii IBC 2021, Section 1707 Alternative Test Procedure, 1707.1 General
- xxxviii See Section 11 for the distilled building code definition of **Approved**
- xxxix [Los Angeles Municipal Code, SEC. 98.0503. TESTING AGENCIES](#)
- xl <https://up.codes/viewer/california/ca-building-code-2022/chapter/17/special-inspections-and-tests#1707.1>
- xli New York City, The Rules of the City of New York, § 101-07 Approved Agencies
- xlii New York City, The Rules of the City of New York, § 101-07 Approved Agencies
- xliii https://up.codes/viewer/new_jersey/ibc-2018/chapter/17/special-inspections-and-tests#1707.1
- xliv <https://www.nj.gov/dca/divisions/codes/codreg/ucc.html>
- xlv <https://www.ecfr.gov/current/title-24/subtitle-B/chapter-XX/part-3282/subpart-A/section-3282.14>
- xlvi <https://www.ecfr.gov/current/title-24/subtitle-B/chapter-XX/part-3280>
- xlvii IBC 2021, Section 1706 Design Strengths of Materials, 1706.2 New Materials. Adopted law pursuant to IBC model code language 1706.2.
- xlviii IBC 2021, Section 1707 Alternative Test Procedure, 1707.1 General. Adopted law pursuant to IBC model code language 1707.1.
- xlix <https://www.nspe.org/resources/issues-and-advocacy/professional-policies-and-position-statements/regulation-professional> AND <https://apassociation.org/list-of-engineering-boards-in-each-state-archive/>
- i [IBC 2021, Section 1706 Design Strengths of Materials, Section 1706.1 Conformance to Standards](#) Adopted law pursuant to IBC model code language 1706.1.
- ii <https://iaf.nu/en/about-iaf-mla/#:~:text=it%20is%20required%20to%20recognise%20certificates%20and%20validation%20and%20verification%20statements%20issued%20by%20conformity%20assessment%20bodies%20accredited%20by%20all%20other%20signatories%20of%20the%20IAF%20MLA%2C%20with%20the%20appropriate%20scope>
- iii True for all ANAB accredited product evaluation agencies and all International Trade Agreements.
- iiii <https://www.justice.gov/crt/deprivation-rights-under-color-law> AND <https://www.justice.gov/atr/mission>